



*Relay with start capacitors potential relay*

KCP 422-9

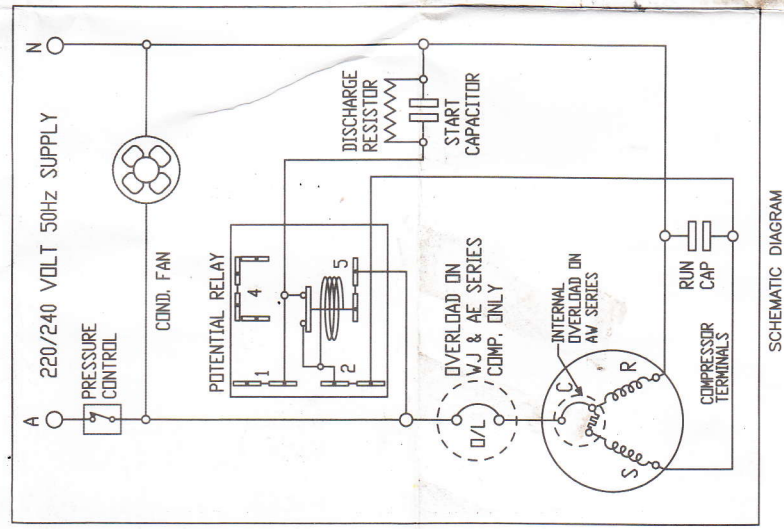

P.V.C. SHEATHING REQUIRED FOR LOCKING PURPOSES 50mm EXAMPLE CABLE IN POSITION

(DETAIL "A")

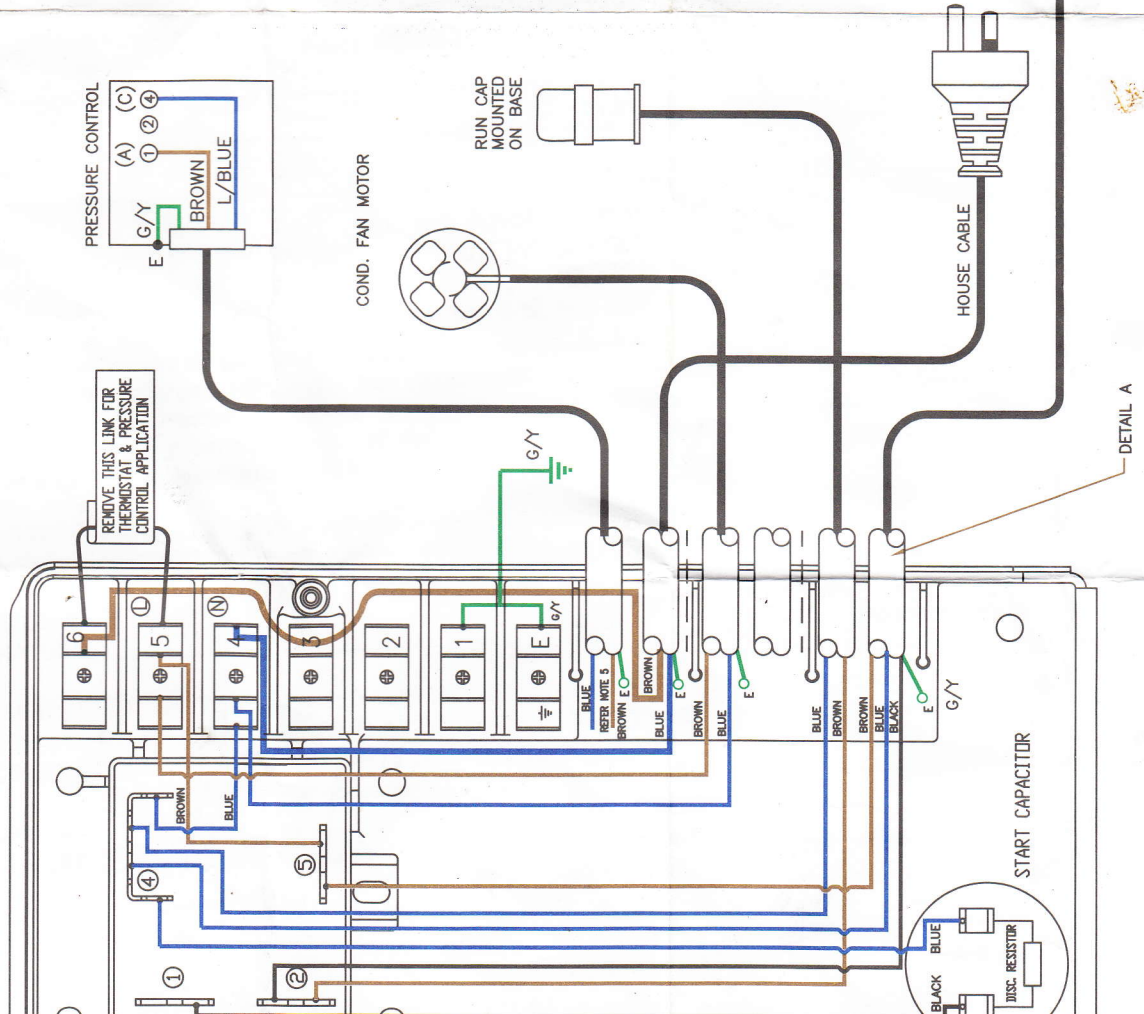

- NOTES:**
1. REMOVE KNOCKOUTS AS INDICATED - TWO (2) FLEXIBLE CORED CABLES TO EACH KNOCKOUT
  2. WIRE TERMINAL BEFORE INSERTION OF CABLE INTO KNOCKOUT POSITIONS.
  3. " " INDICATES WHICH CABLES ARE PLACED TO A PARTICULAR KNOCKOUT.
  4. ALL GREEN & YELLOW CABLES CONNECT TO TERMINALS IDENTIFIED AS AN EARTH.
  5. WHEN FITTING PRESS. CONTROL, REMOVE LINK ON TERM. 5 & 6, THEN WIRE BLUE LEAD TO 5, BROWN LEAD TO 6 & GRN/YLW TO EARTH.