




WARNING

HIGH VOLTAGE! DISCONNECT ALL POWER BEFORE SERVICING.
MULTIPLE POWER SOURCES MAY BE PRESENT. FAILURE TO DO SO
MAY CAUSE PROPERTY DAMAGE, PERSONAL INJURY OR DEATH.




ARUF**14**/ARPT**14**

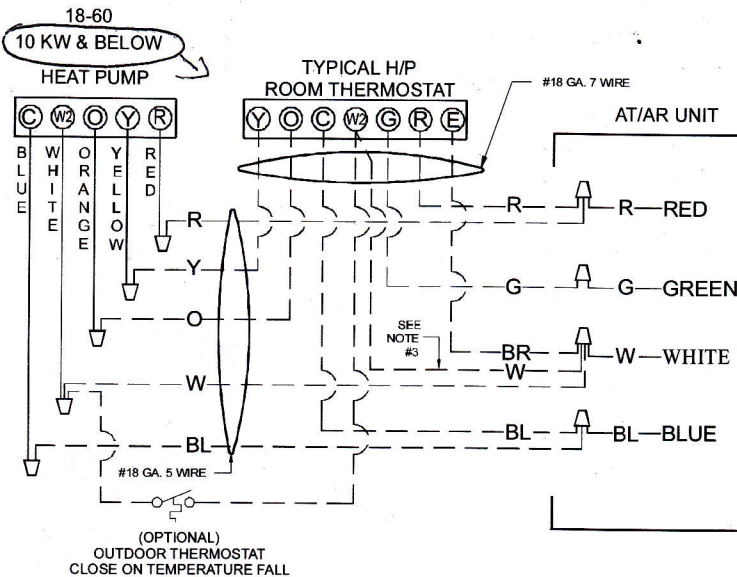

#18 GA. 6 WIRE NEEDED WHEN OT IS USED

ARUF**14**/ARPT**14**

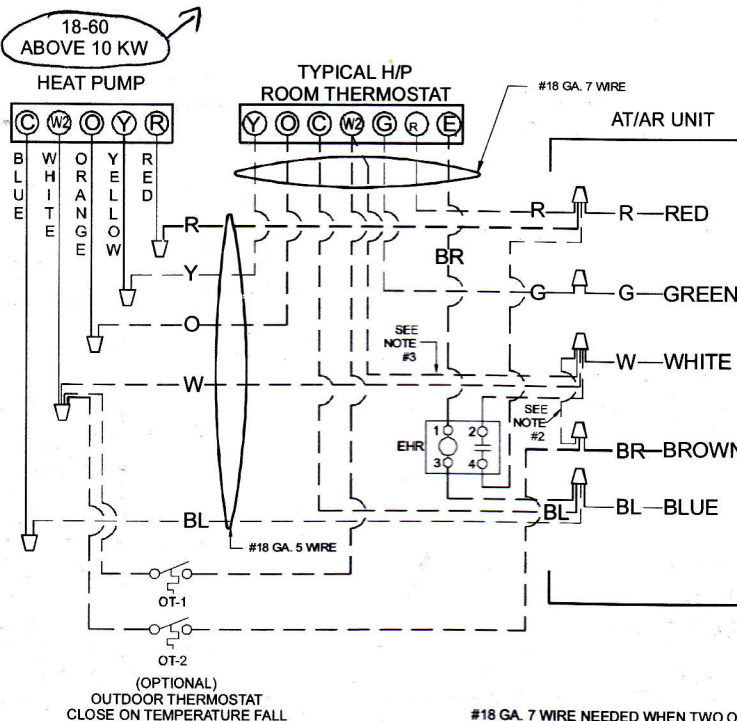

#18 GA. 7 WIRE NEEDED WHEN TWO OT'S ARE USED

NOTES:

- 1) OUTDOOR THERMOSTAT (OT-1) SHOULD BE THE FIRST TO CLOSE AND THE LAST TO OPEN.
- 2) CONNECT WHITE AND BROWN WIRES FROM AIR-HANDLER TOGETHER IF OT-2 IS NOT USED.
- 3) REMOVE WIRE WHEN USING OUTDOOR THERMOSTAT

NOMENCLATURE

OT—OUTDOOR THERMOSTAT (OPTIONAL)
 EHR—EMERGENCY HEAT RELAY (OPTIONAL)

COLOR CODES

R—RED
 Y—YELLOW
 BL—BLUE
 BR—BROWN
 O—ORANGE
 W—WHITE
 G—GREEN

IMPORTANT: If outdoor thermostat is not used, tie white and brown wires from Air Handler together.

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.